



EZH2O™ System` Filtered LVRCGRN Cooler/ Bottle Filling Station

Models LVRCGRN8WS & LVRCGRNTL8WS


PRODUCT FEATURES

- Complete filtered cooler and bottle filling station in a consolidated space saving ADAcompliant design
- Features energy-efficient refrigeration system
- Sanitary, no-touch, sensor activation with automatic 20-second shut-off timer
- WaterSentry[®] Plus 3000 gallon filter included
- Vandal-Resistant StreamSaver™ Bubbler
- Silver Ion anti-microbial protection
- Quick fill rate is 1.1 gpm for refrigerated units and 1.5 gpm for non-refrigerated units
- · Laminar flow provides minimal splash
- Real drain system eliminates standing water
- Visual user interface display includes:
 - Filter Monitor indicating when replacement is necessary
 - Green Ticker[™] counting the quantity of bottles saved from waste

Unit shall provide 8.0 gph of 50° F water at 90° F ambient and 80° F inlet water. Bottle filling unit shall include an electronic sensor for no-touch activation with an automatic 20-second shut-off timer. Shall provide 1.1-1.5* gpm flow rate with laminar flow to minimize splashing. Shall include antimicrobial protected plastic components to prevent mold and mildew. Cooler unit shall have pushbutton activation and water-efficient Stream-Saver™ bubbler. Shall include the WaterSentry® Plus filter, certified to NSF/ANSI 42 and 53 for lead reduction, with visual monitor to indicate when replacement is necessary. Shall include high-efficiency refrigeration system. Shall meet ADA guidelines. Shall be lead-free design which meets Safe Drinking Water Act and is certified to NSF/ANSI 61 and California AB1953. Shall be certified to UL399 and CAN/CSA 22.2 No. 120.

SUGGESTED SPECIFICATION

IMAGES

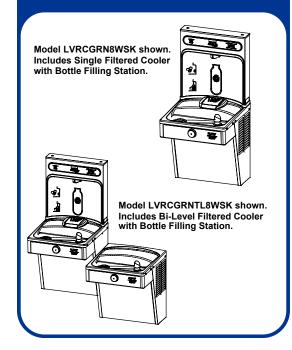

- ☐ 51300C Replacement filter (available as single or packs of 3, 12, 24 or 48)
- ☐ 36292C Receptacle Adaptor Plug

OPTIONAL ACCESSORIES

Ideal for use in:

- Educational facilities
- Healthcare facilities
- · Sport and fitness centers
- Airports
- Office buildings
- Other commercial buildings

APPLICATIONS

2222 Camden Court Oak Brook, IL 60523 Phone: 630-572-3192 Web: Elkayusa.com



Third Party Certified to:


- UL399 and CAN/CSA 22.2 No. 120
- Lead-free compliance including NSF/ANSI 61 and CA AB1953
- NSF/ANSI 42 and 53 (Filter)

In keeping with our policy of continuing product improvement, Elkay reserves the right to change specifications without notice.

© 2011 Elkay



ROUGH - IN DIMENSIONS

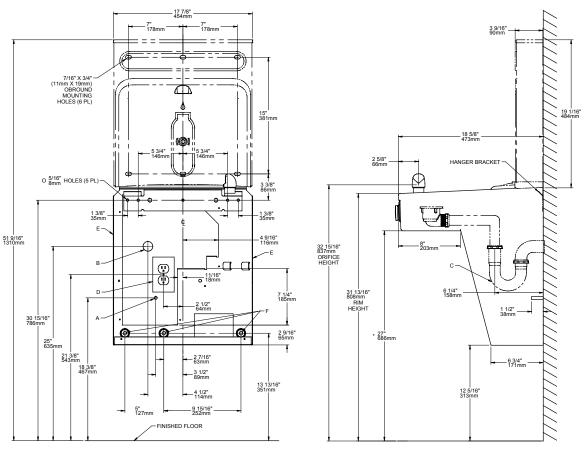


*Reduce Height By 3" For Installation Of Children's ADA Cooler

LEGEND:

- A = Recommended Water Supply Location 3/8 O.D. Shut-Off Valve (Not Furnished) to accept 3/8" O.D. unplated copper tube
- B = Recommended Location For Waste Outlet To Accommodate 1-1/2" Nominal Drain.
- C = 1-1/2" Trap (Not Furnished)
- D = Electrical Supply (3) Wire Recessed Box Duplex Outlet
- E = Insure proper ventilation by maintaining 6" (152mm) minimum clearance from cabinet louvers to wall.
- F = 7/16" Bolt Holes For Fastening Unit To Wall



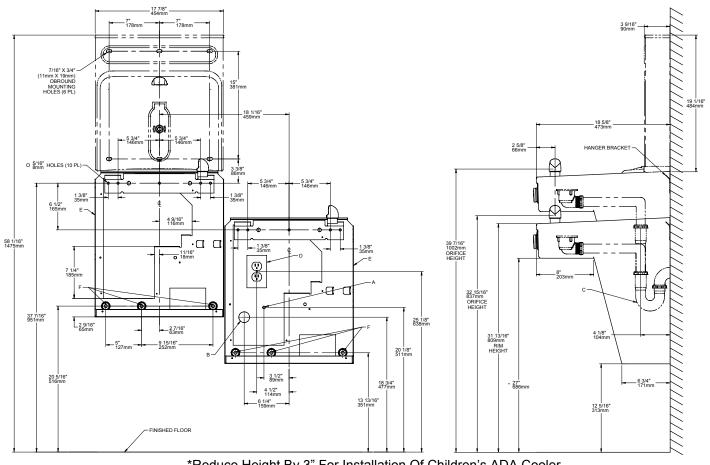

LEGEND:

*Reduce Height By 3" For Installation Of Children's ADA Cooler

- A = Recommended Water Supply Location 3/8 O.D. Shut Off Valve (Not Furnished) to accept 3/8" O.D. unplated copper tube
- B = Recommended Location For Waste Outlet To Accommodate 1-1/2" Nominal Drain.
- C = 1-1/2" Trap (Not Furnished)
- D = Electrical Supply (3) Wire Recessed Box Duplex Outlet
- E = Insure proper ventilation by maintaining 6" (152mm) minimum clearance from cabinet louvers to wall.
- F = 7/16" Bolt Holes For Fastening Unit To Wall